




Transition Design Service
 "From Ideas to Reality"
 201 W. Villa Maria Road * Bryan, Texas 77801 * (979) 822-7777

© COPYRIGHT 2009
 TRANSITION DESIGN SERVICE
 All rights reserved. No part of this document or the ideas and designs incorporated herein, in an instrument of professional services, may be reproduced by photocopying, recording, or by any other means, or stored, transmitted or transmitted in or by any combination of other systems without the written permission of Transition Design Service.

A NEW HOME FOR
BK HOME DEVELOPMENT, INC.
 COLLEGE STATION TEXAS


DATE: JUNE 2012

A1

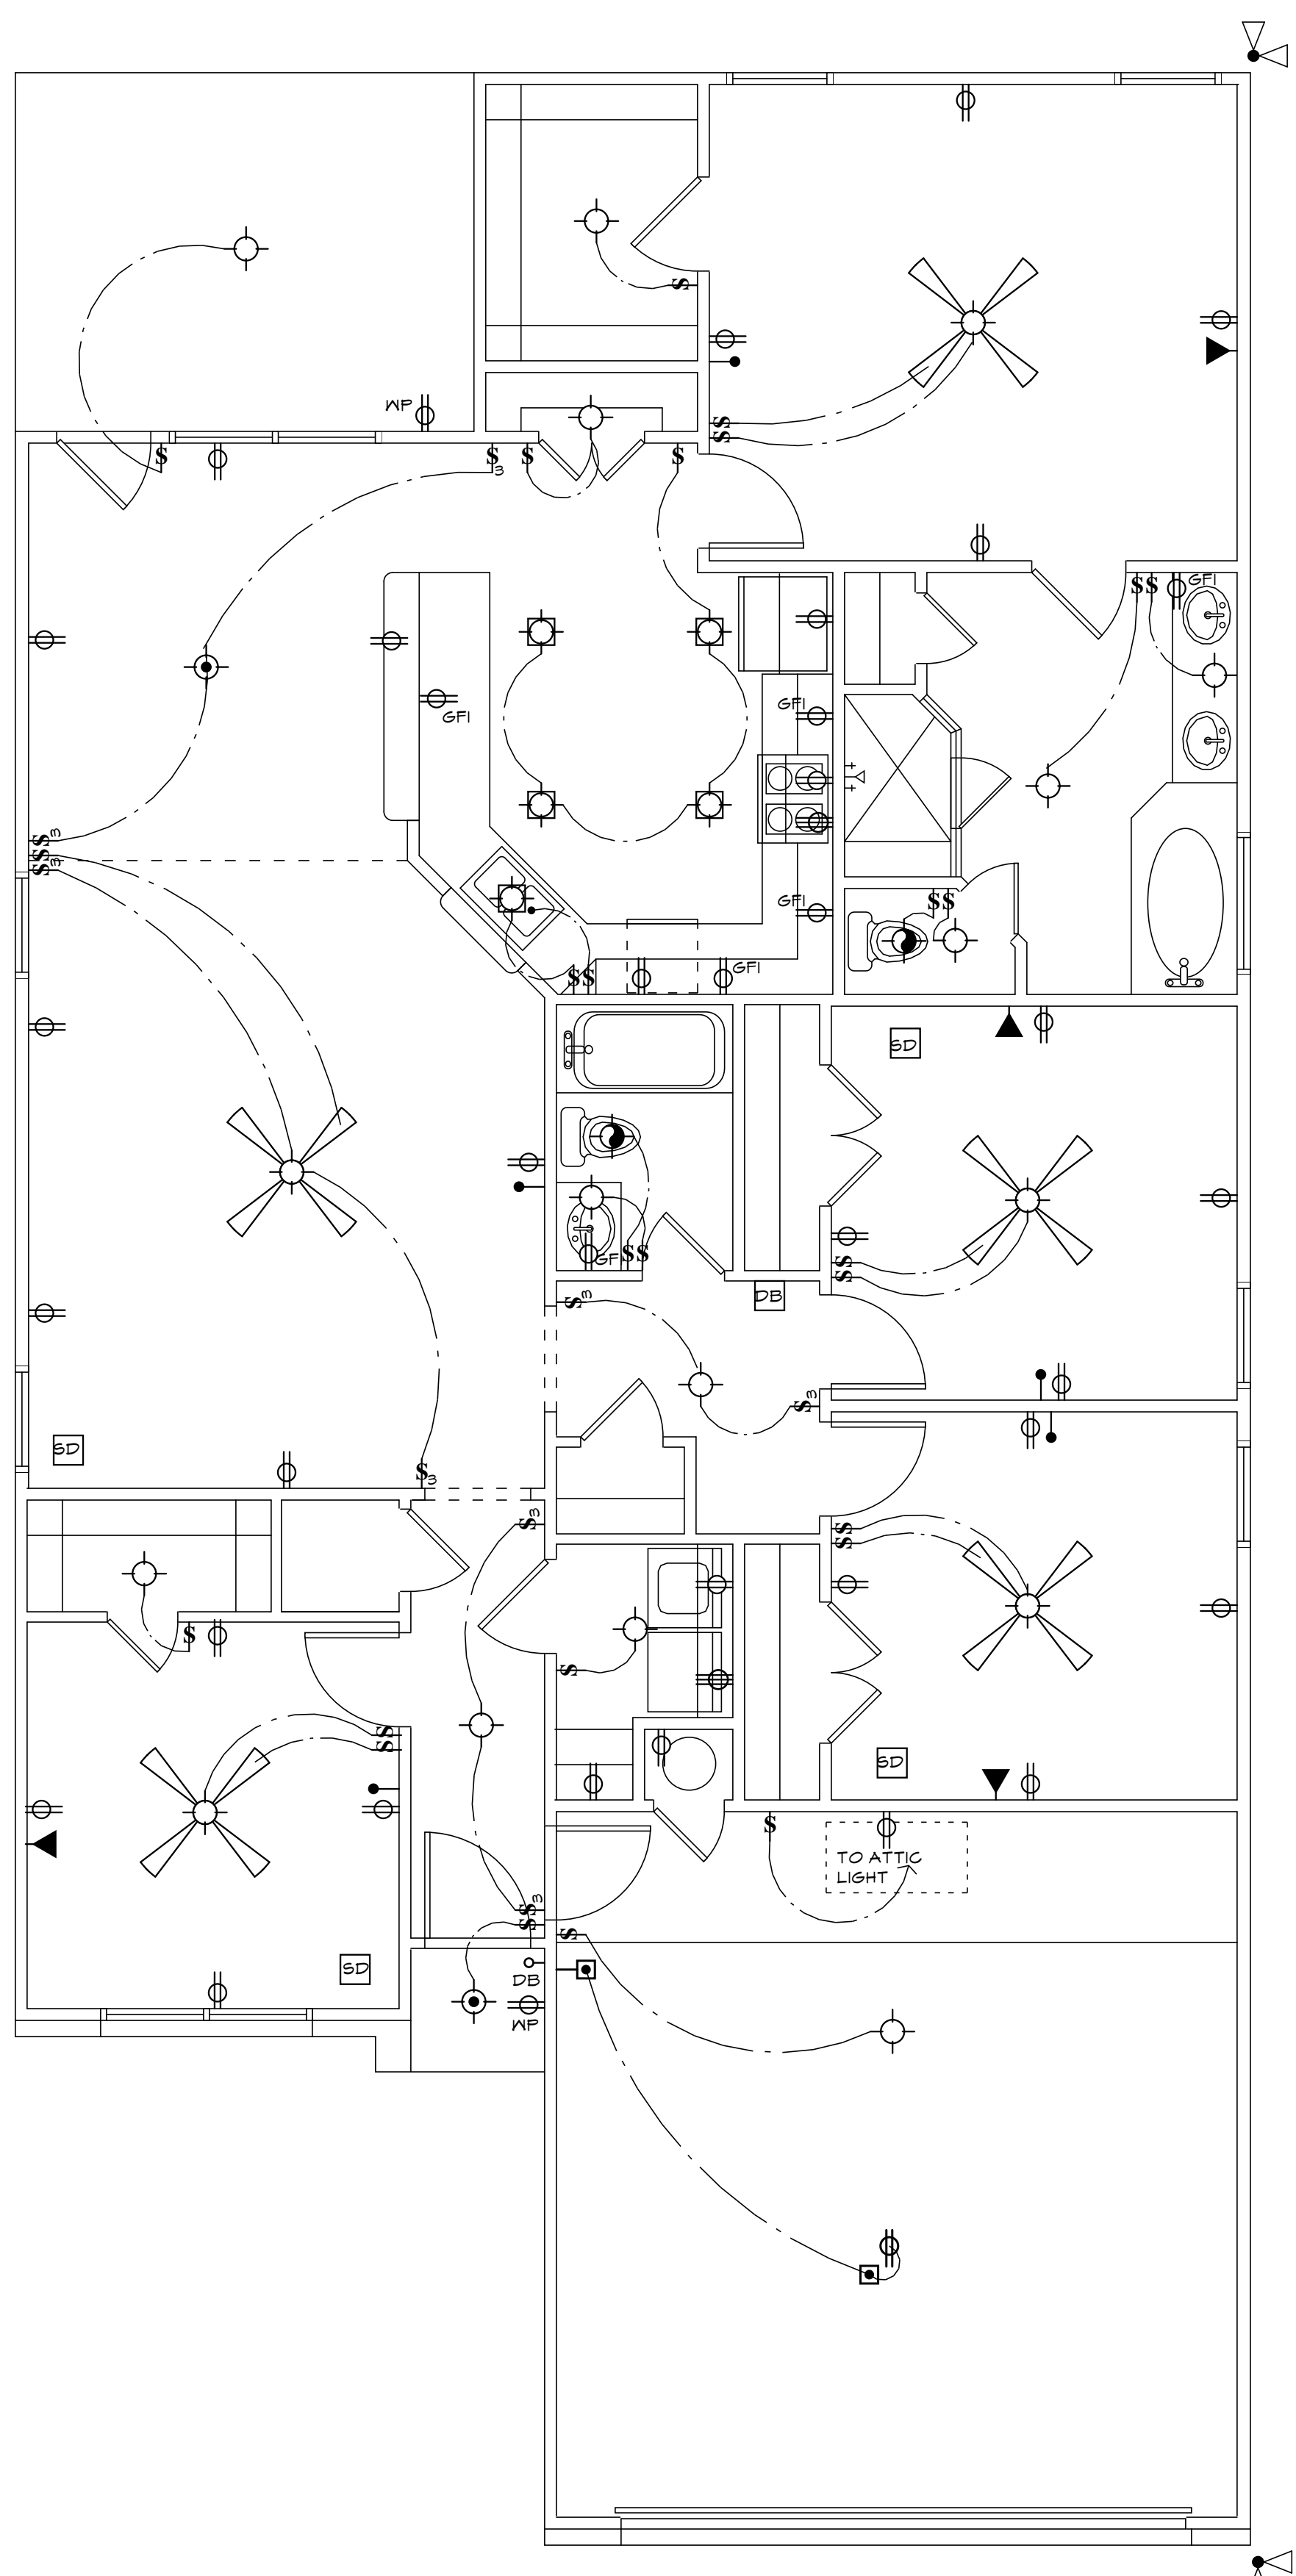


- DUPLEX OUTLET
- GROUND FAULT ISOLATED OUTLET
- WATERPROOF DUPLEX OUTLET
- SPECIAL PURPOSE OUTLET
- DUPLEX FLOOR OUTLET
- TELEPHONE JACK
- CABLE OUTLET
- SWITCH
- 3-WAY SWITCH
- SURFACE MOUNTED INCANDESCENT
- PENDANT MOUNTED INCANDESCENT
- RECESSED INCANDESCENT
- SECURITY LIGHT
- EXHAUST FAN
- DOOR BELL
- DOOR BELL CHIMES
- SMOKE DETECTOR
- CEILING FAN W/ LIGHT KIT

HEATED AREA: 1674 s.f.
 SLAB AREA: 2242 s.f.

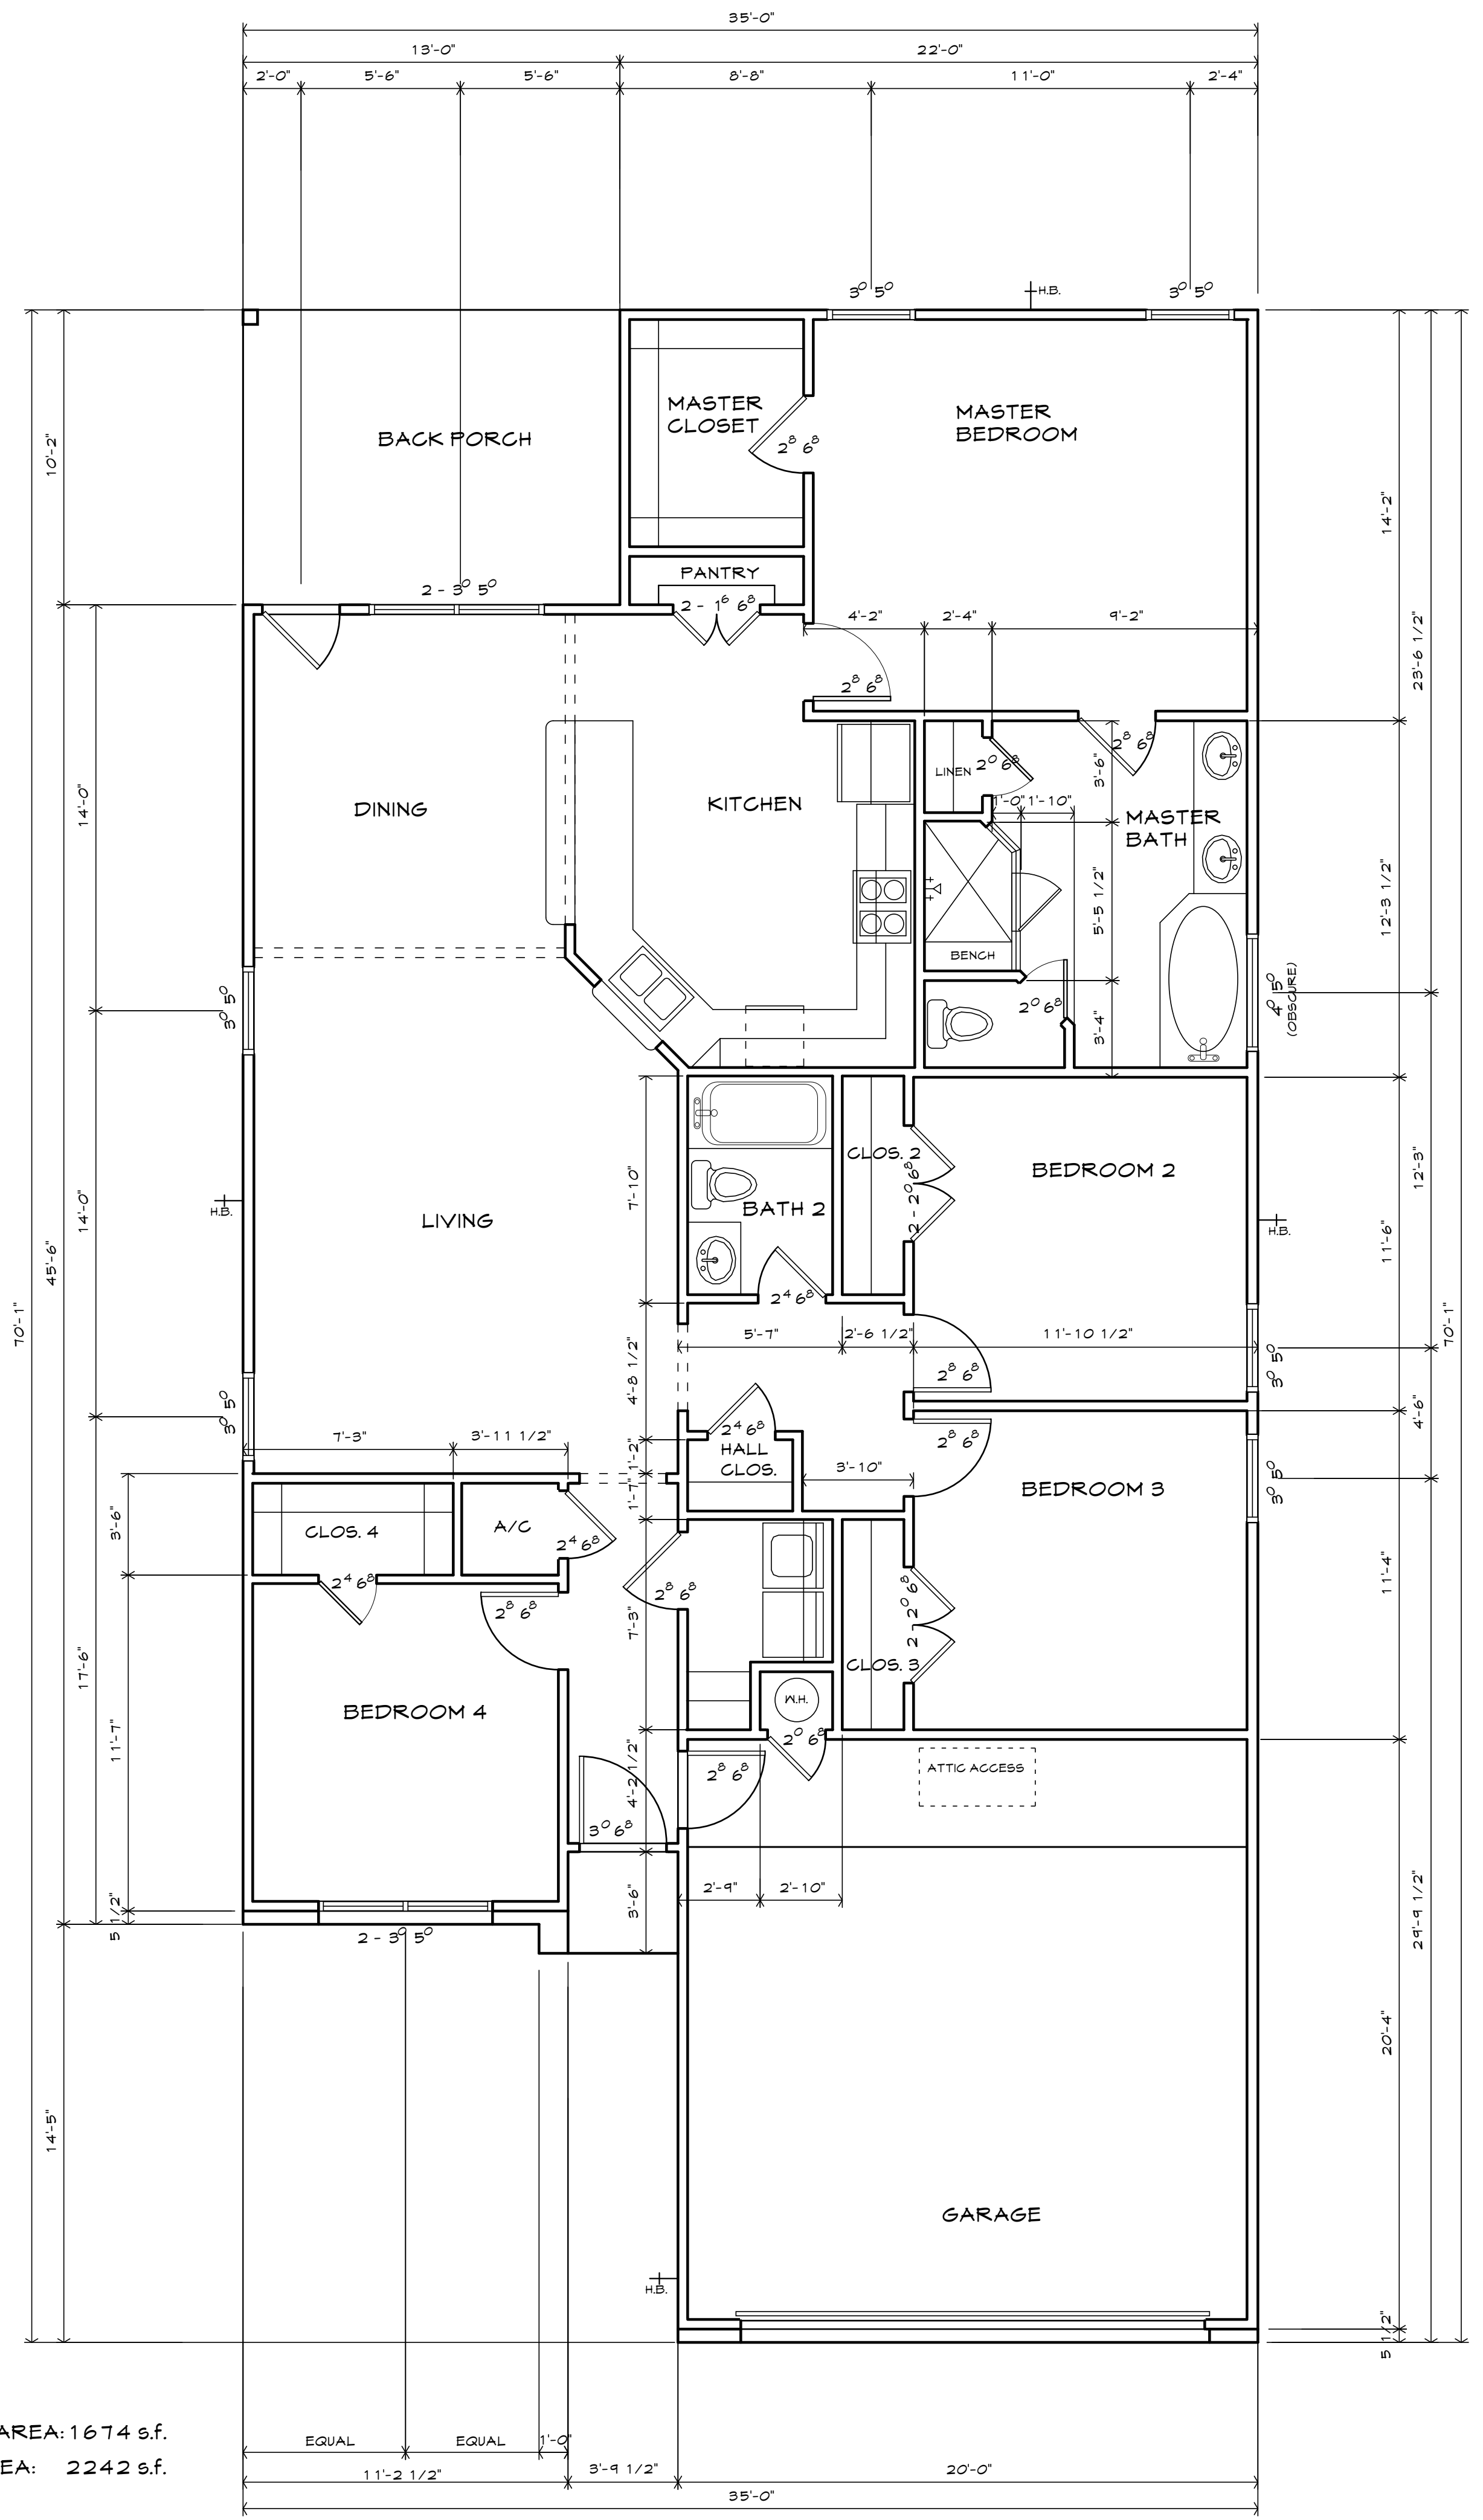


2 FLOOR PLAN
 1/4" = 1'-0"

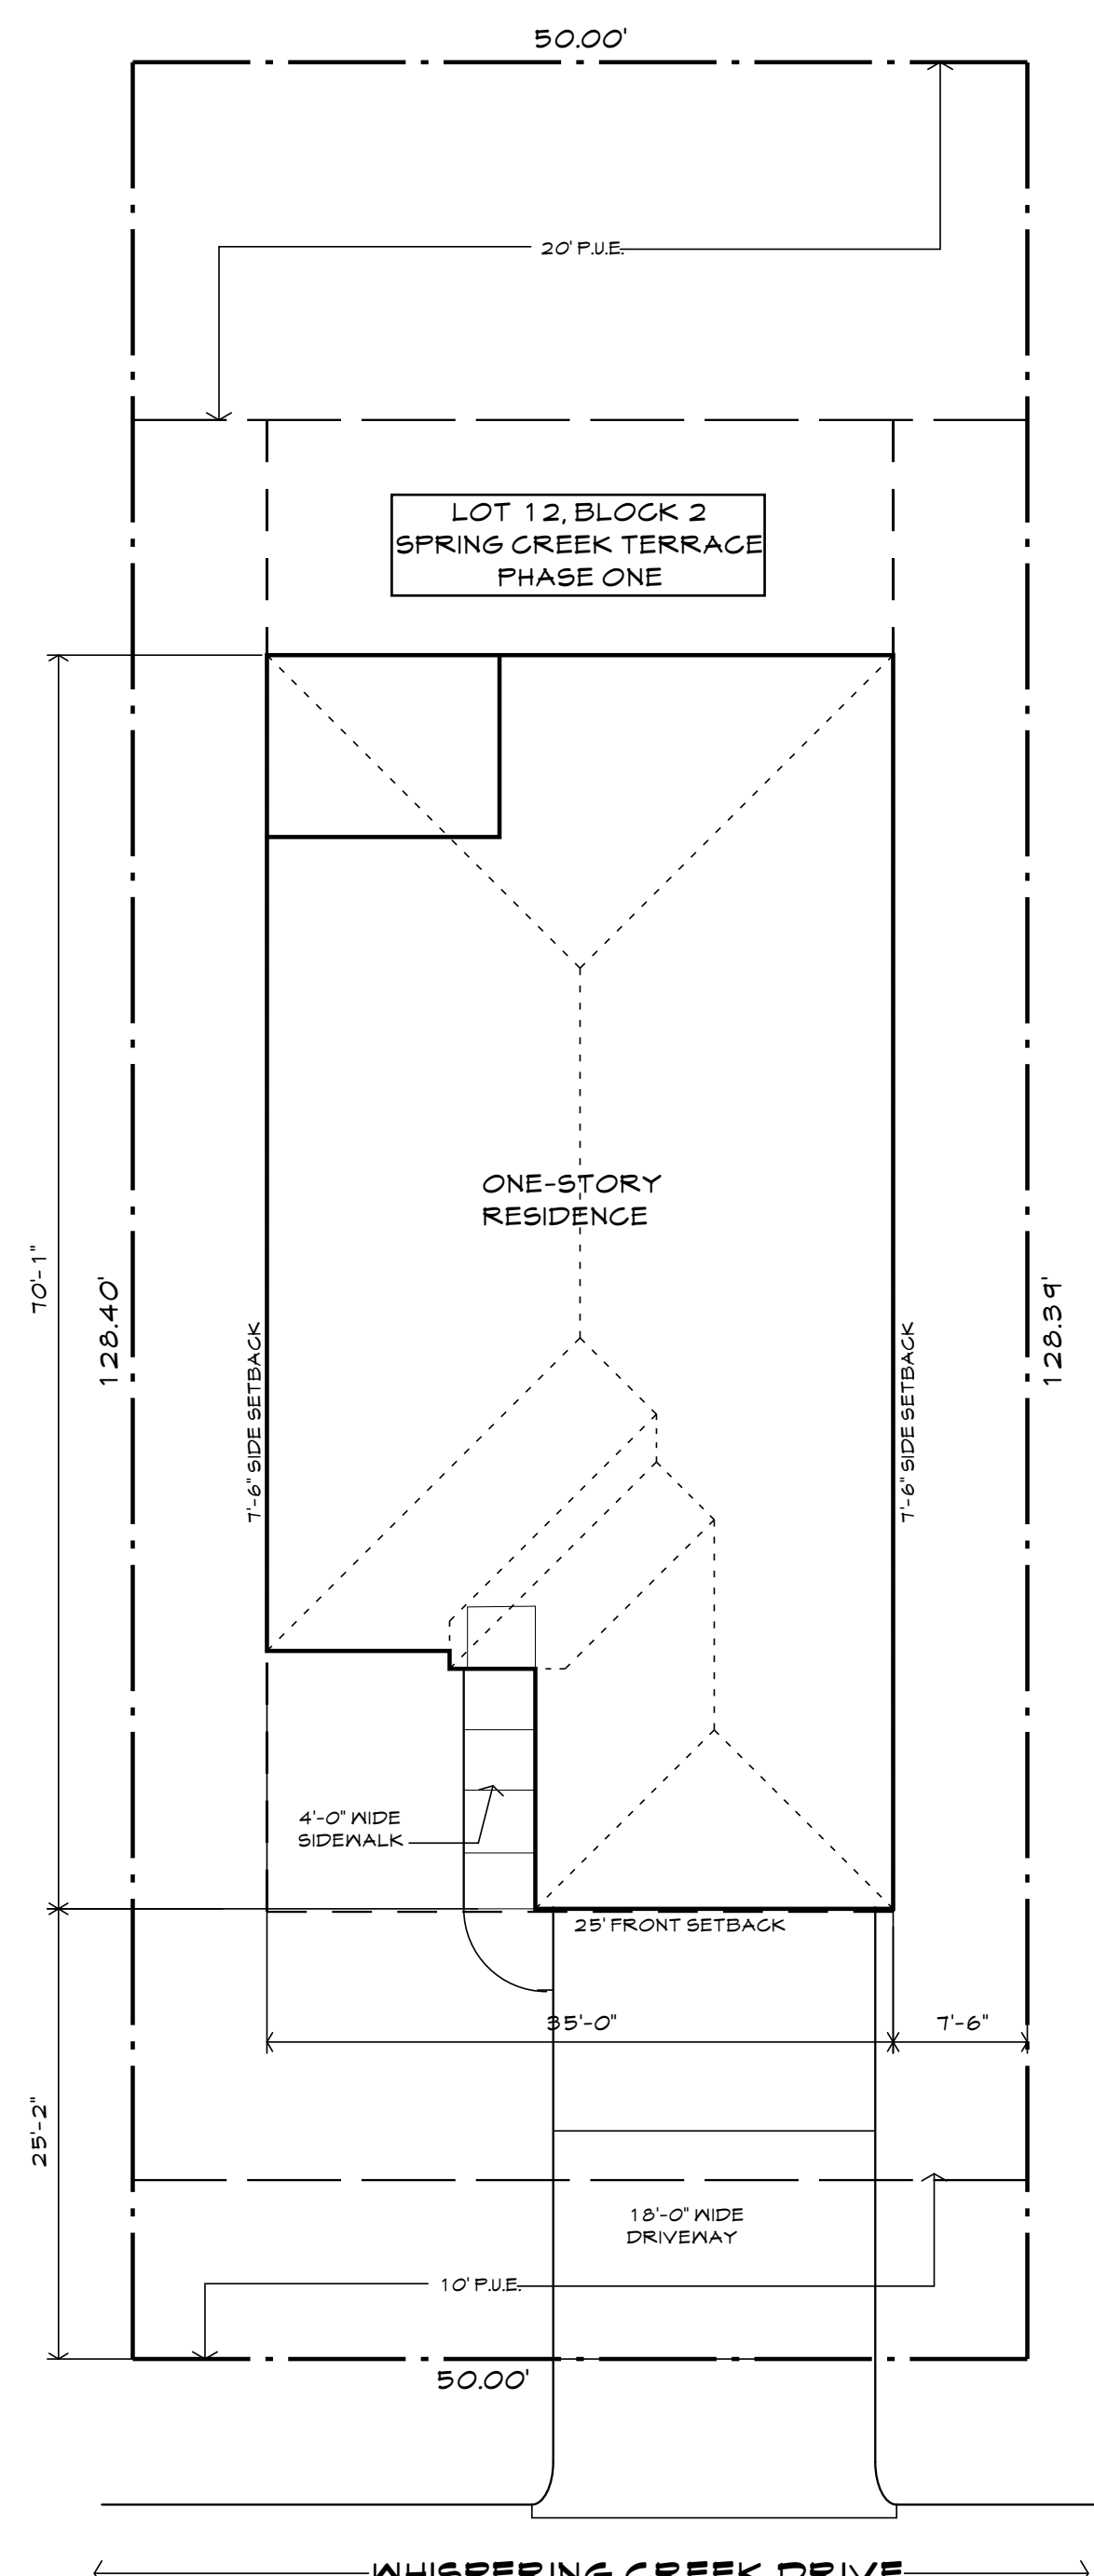

1 SITE PLAN
 1/4" = 1'-0"

3 ELECTRICAL PLAN
 1/4" = 1'-0"

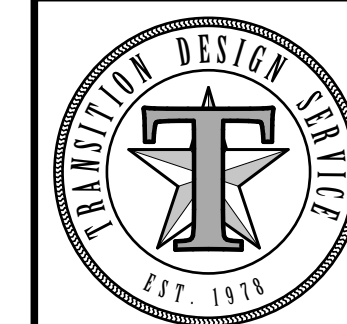

Transition Design Service
 "From Ideas to Reality"

© COPYRIGHT 2009
 TRANSITION DESIGN SERVICE
 All rights reserved. No part of this document or the ideas and designs incorporated herein, in an instrument of professional services, may be reproduced by photocopying, recording, or by any other means, or stored, processed or transmitted in or by any computer or other system without the written permission of Transition Design Service.

A NEW HOME FOR
BK HOME DEVELOPMENT, INC.
 COLLEGE STATION TEXAS

DATE: JUNE 2012

A2

FRAMING NOTES

- All bottom plates that contact concrete shall be 'treated' lumber.
- All wall studs shall be 2x4 at 16" on center unless noted otherwise.
- Exterior sheathing shall be 7/16" oriented strand board (OSB).
- Headers, joists and rafters shall be sized according to the Span Table provided or by using the span table provided by the City Building Inspections Department.
- All ridges, hips, and valleys shall be one size larger than rafters.
- Roof system shall include 7/16" OSB, 15# felt, and composition shingles.
- Blocking shall be provided in appropriate locations.
- Provide 2x6 rafter ties at all plates where joists run perpendicular to rafters.
- Provide 2-2x6 strong back at spans over 10'-0".
- Soffits shall be 3/8" AC grade plywood with 8"x16" soffit vents at 8'-0" o.c.
- HVAC subcontractor shall design HVAC system and duct layouts. HVAC and plumbing subcontractors shall coordinate any special framing requirements such as attic equipment platforms, attic walkways, furr-downs, etc. with the framing subcontractor.
- HVAC subcontractor shall install required appliance vent ducting and other misc. ducting according to city and manufacturer's recommendations.


HEADER SCHEDULE #2 Y.P. or better

SPAN (MAX.)	5'-6"	6'-0"	8'-0"	12'-0"	14'-0"
HEADER SIZE	2-2x4	2-2x6	2-2x8	2-2x10	2-2x12


Use 2-2x12 with 1/2" steel flitch plate, thru bolted for spans up to 20'-0"

SPAN TABLE Southern Forest Products specifications for no. 2 grade fir or yellow pine

CEILING JOISTS	FLOOR JOISTS	RAFTERS	HEADERS
(LIMITED ATTIC STORAGE)	(40 psf LIVE LOAD)	(SLOPES OVER 3:12)	
2x6 at 16" O.C. = 13'-2"	2x12 at 24" O.C. = 15'-4"	2x6 at 24" O.C. = 11'-4"	2-2x4 on edge = 9'-6"
2x8 at 16" O.C. = 17'-5"	2x12 at 16" O.C. = 18'-10"	2x6 at 16" O.C. = 13'-11"	2-2x6 on edge = 4'-6"
2x10 at 16" O.C. = 20'-9"	2x12 at 12" O.C. = 21'-7"	2x6 at 12" O.C. = 16'-1"	2-2x8 on edge = 6'-0"
			2-2x10 on edge = 7'-6"

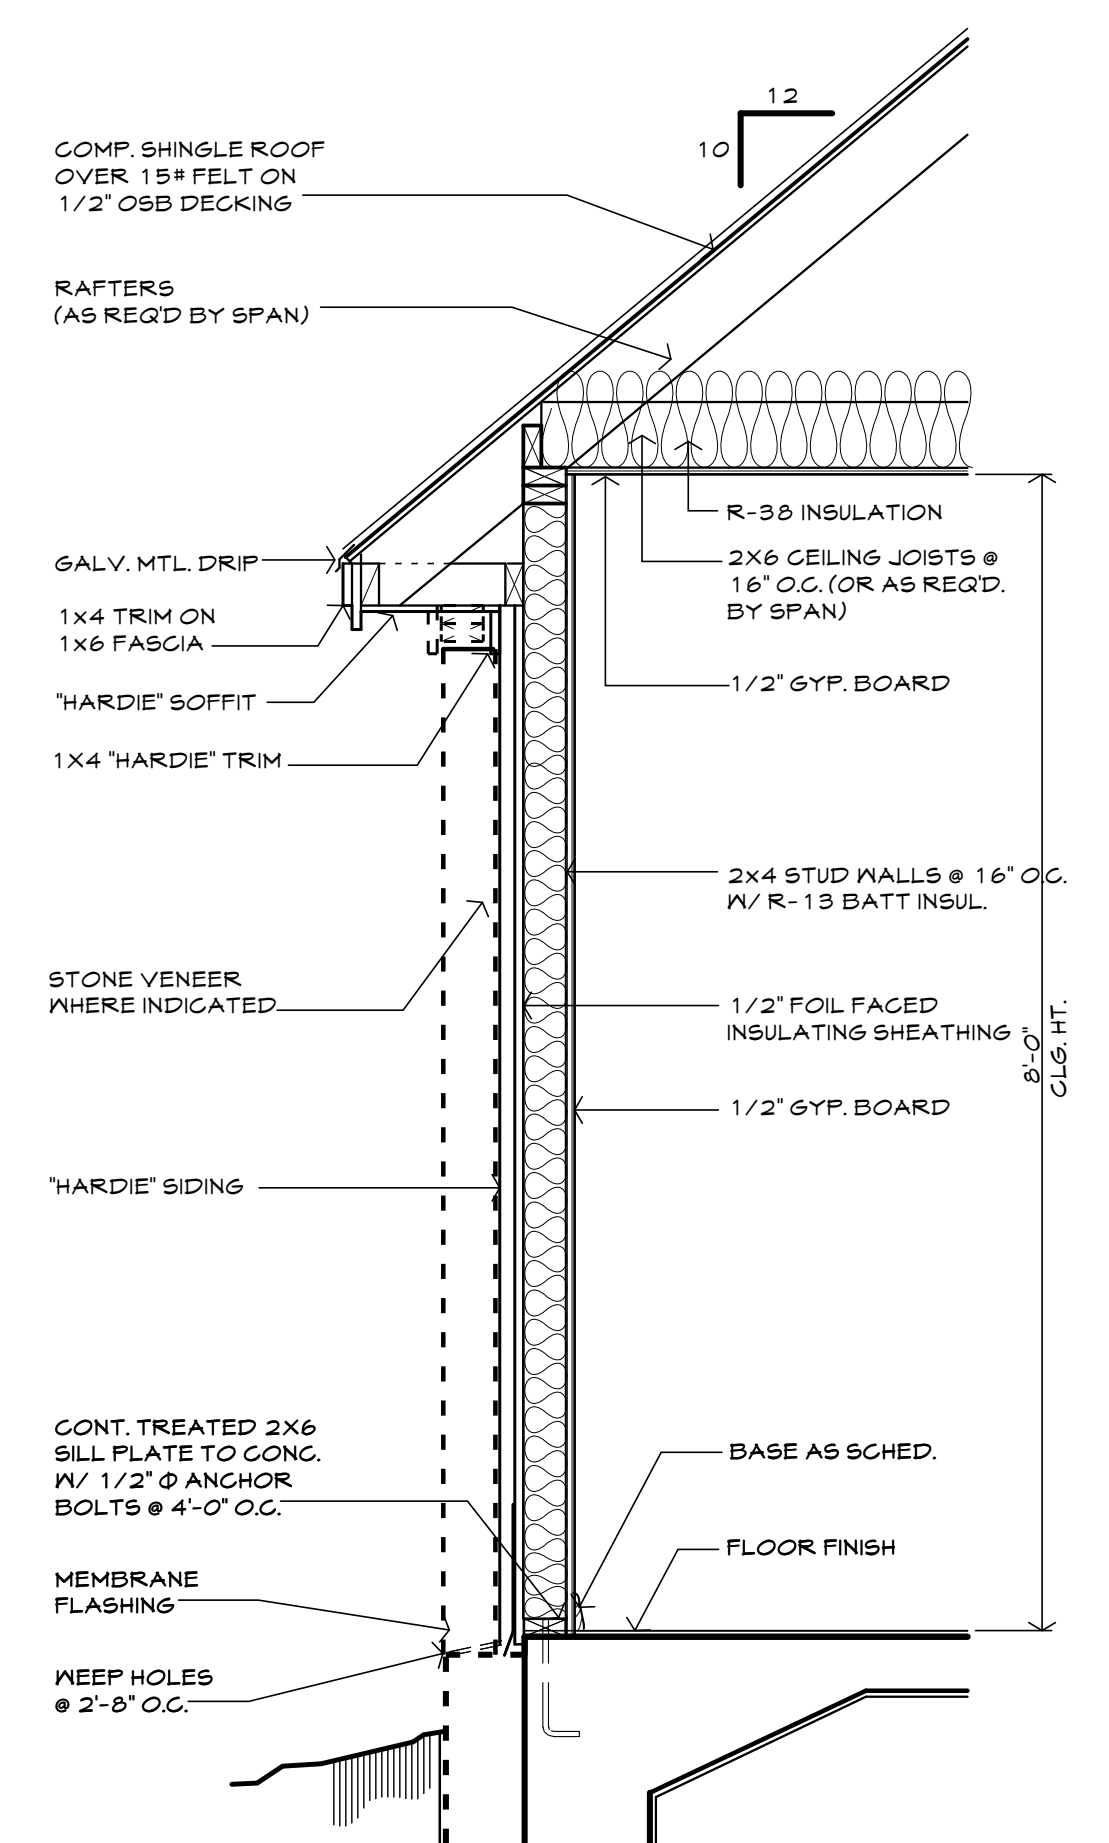


5 TYPICAL WALL SECTION
 3/4" = 1'-0"

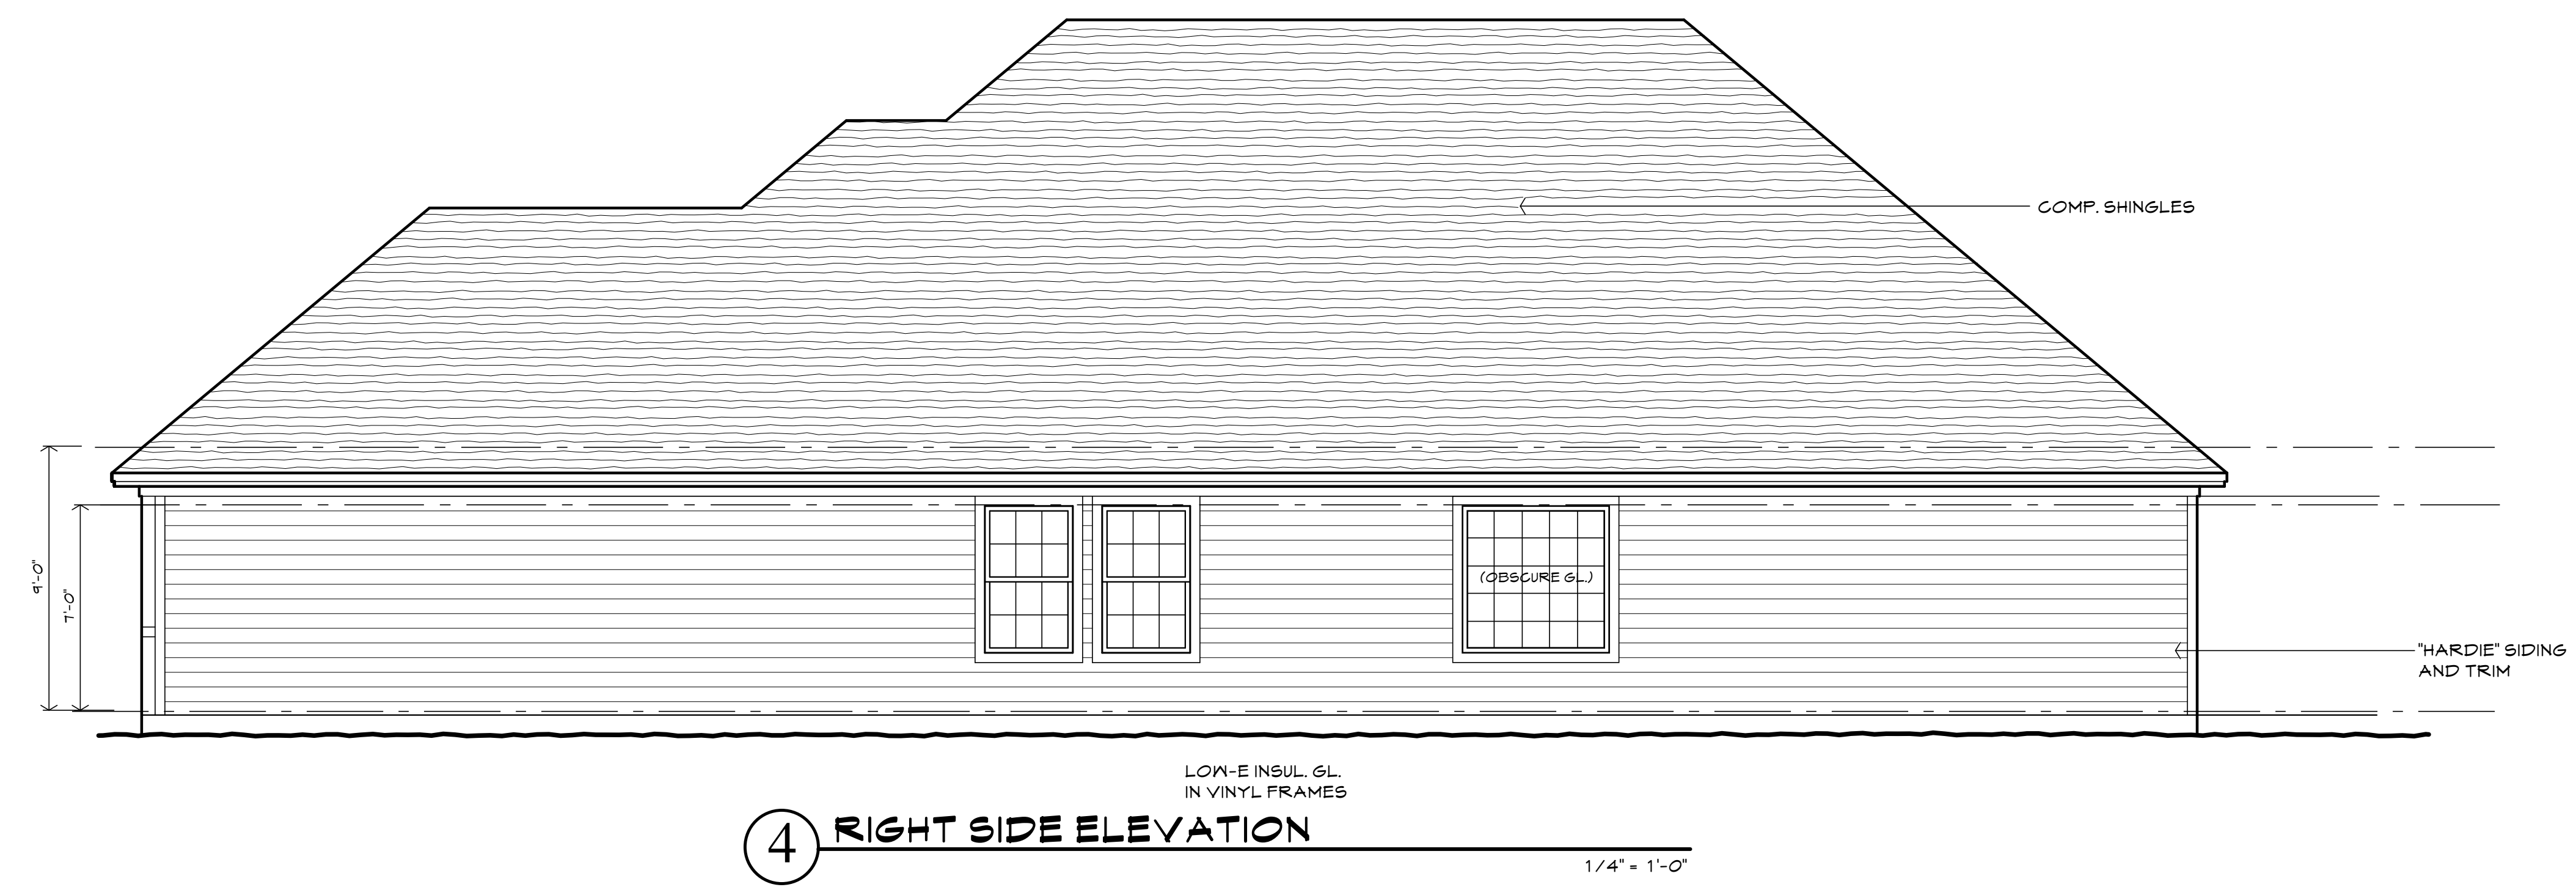

4 RIGHT SIDE ELEVATION
 1/4" = 1'-0"




3 LEFT SIDE ELEVATION
 1/4" = 1'-0"

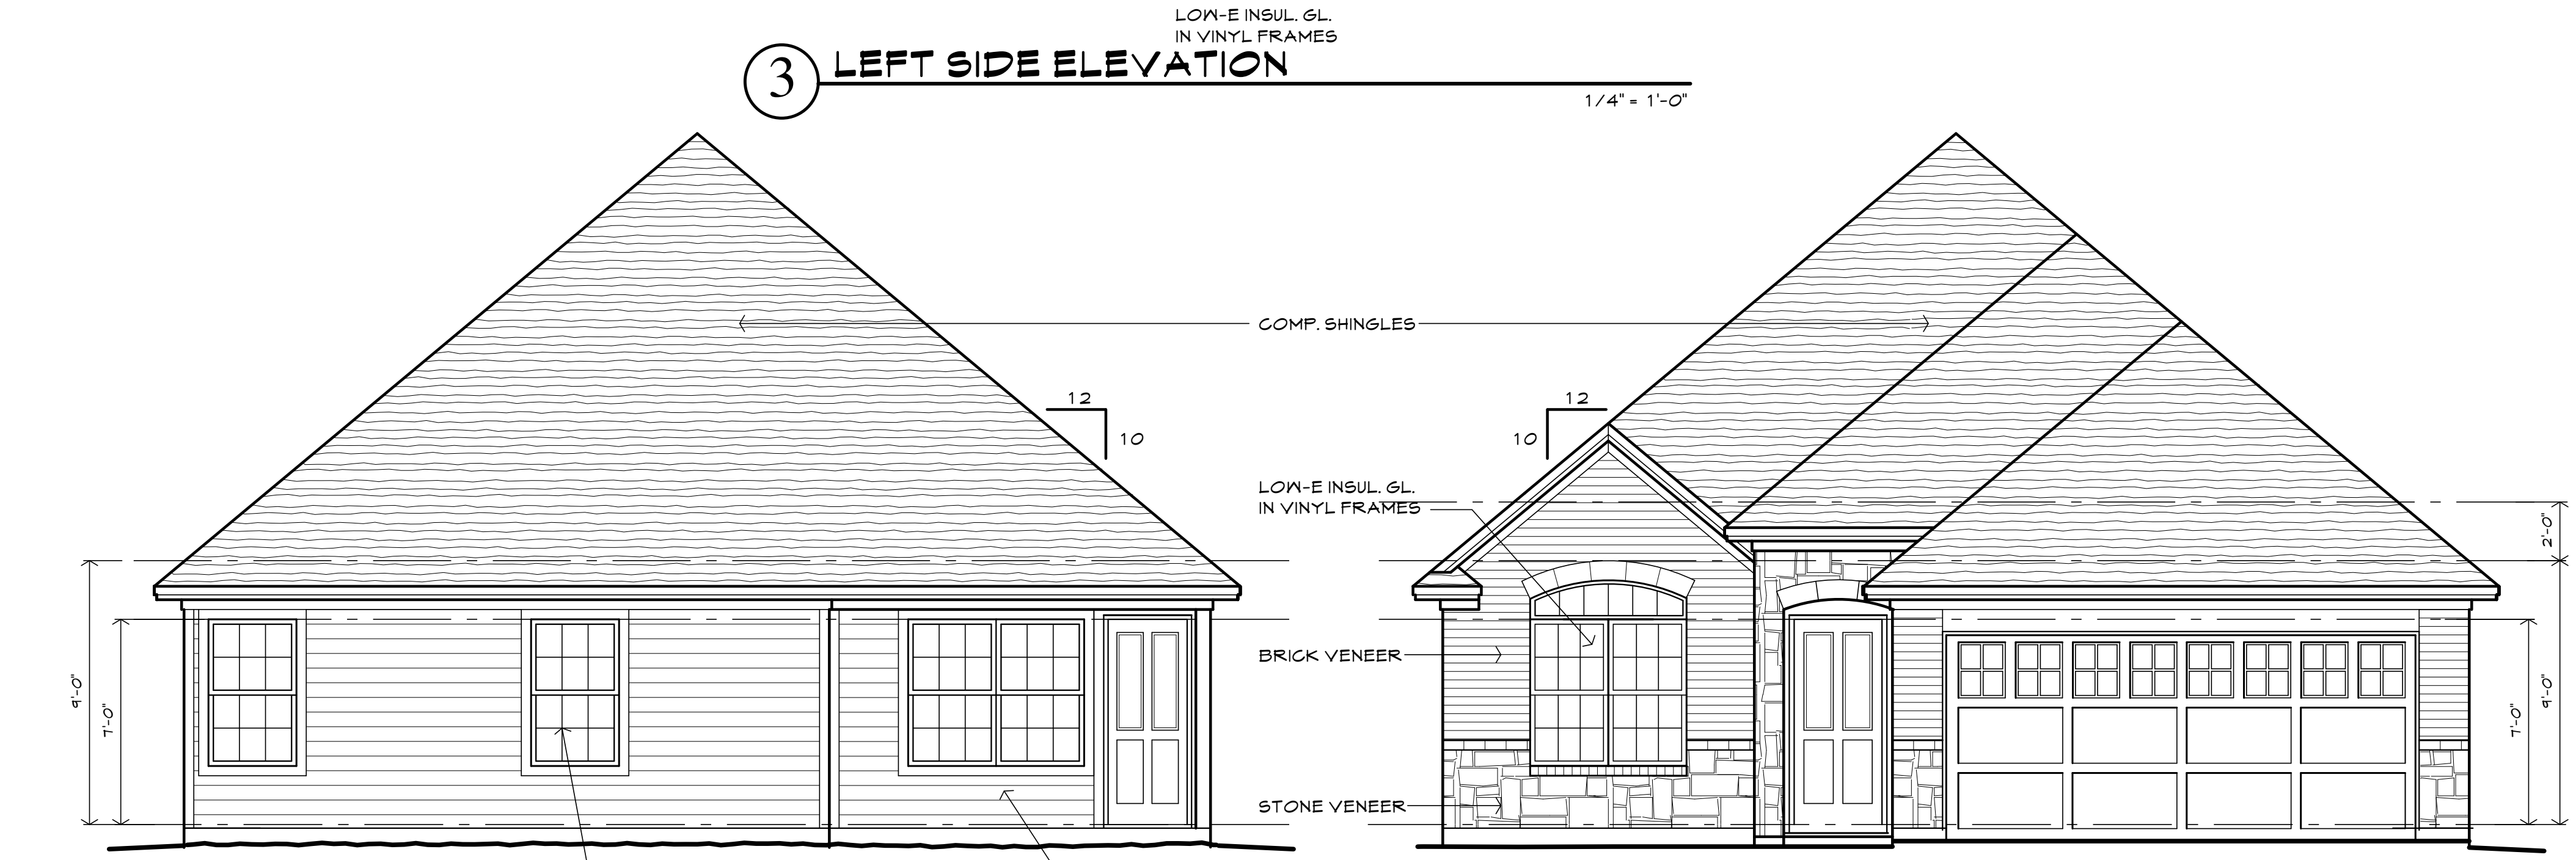

2 BACK ELEVATION
 1/4" = 1'-0"

1 FRONT ELEVATION
 1/4" = 1'-0"

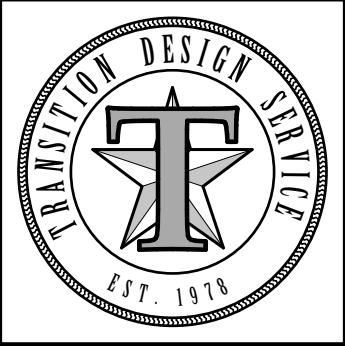


Transition Design Service
 "From Ideas to Reality"

© COPYRIGHT 2009
 TRANSITION DESIGN SERVICE
 All rights reserved. No part of this document or the ideas and designs incorporated herein, in an instrument of professional service, may be reproduced by photocopying, recording, or by any other means, or stored in a retrieval system, without the written permission of Transition Design Service.

A NEW HOME FOR
BK HOME DEVELOPMENT, INC.
 COLLEGE STATION TEXAS

DATE: JUNE 2012

S1

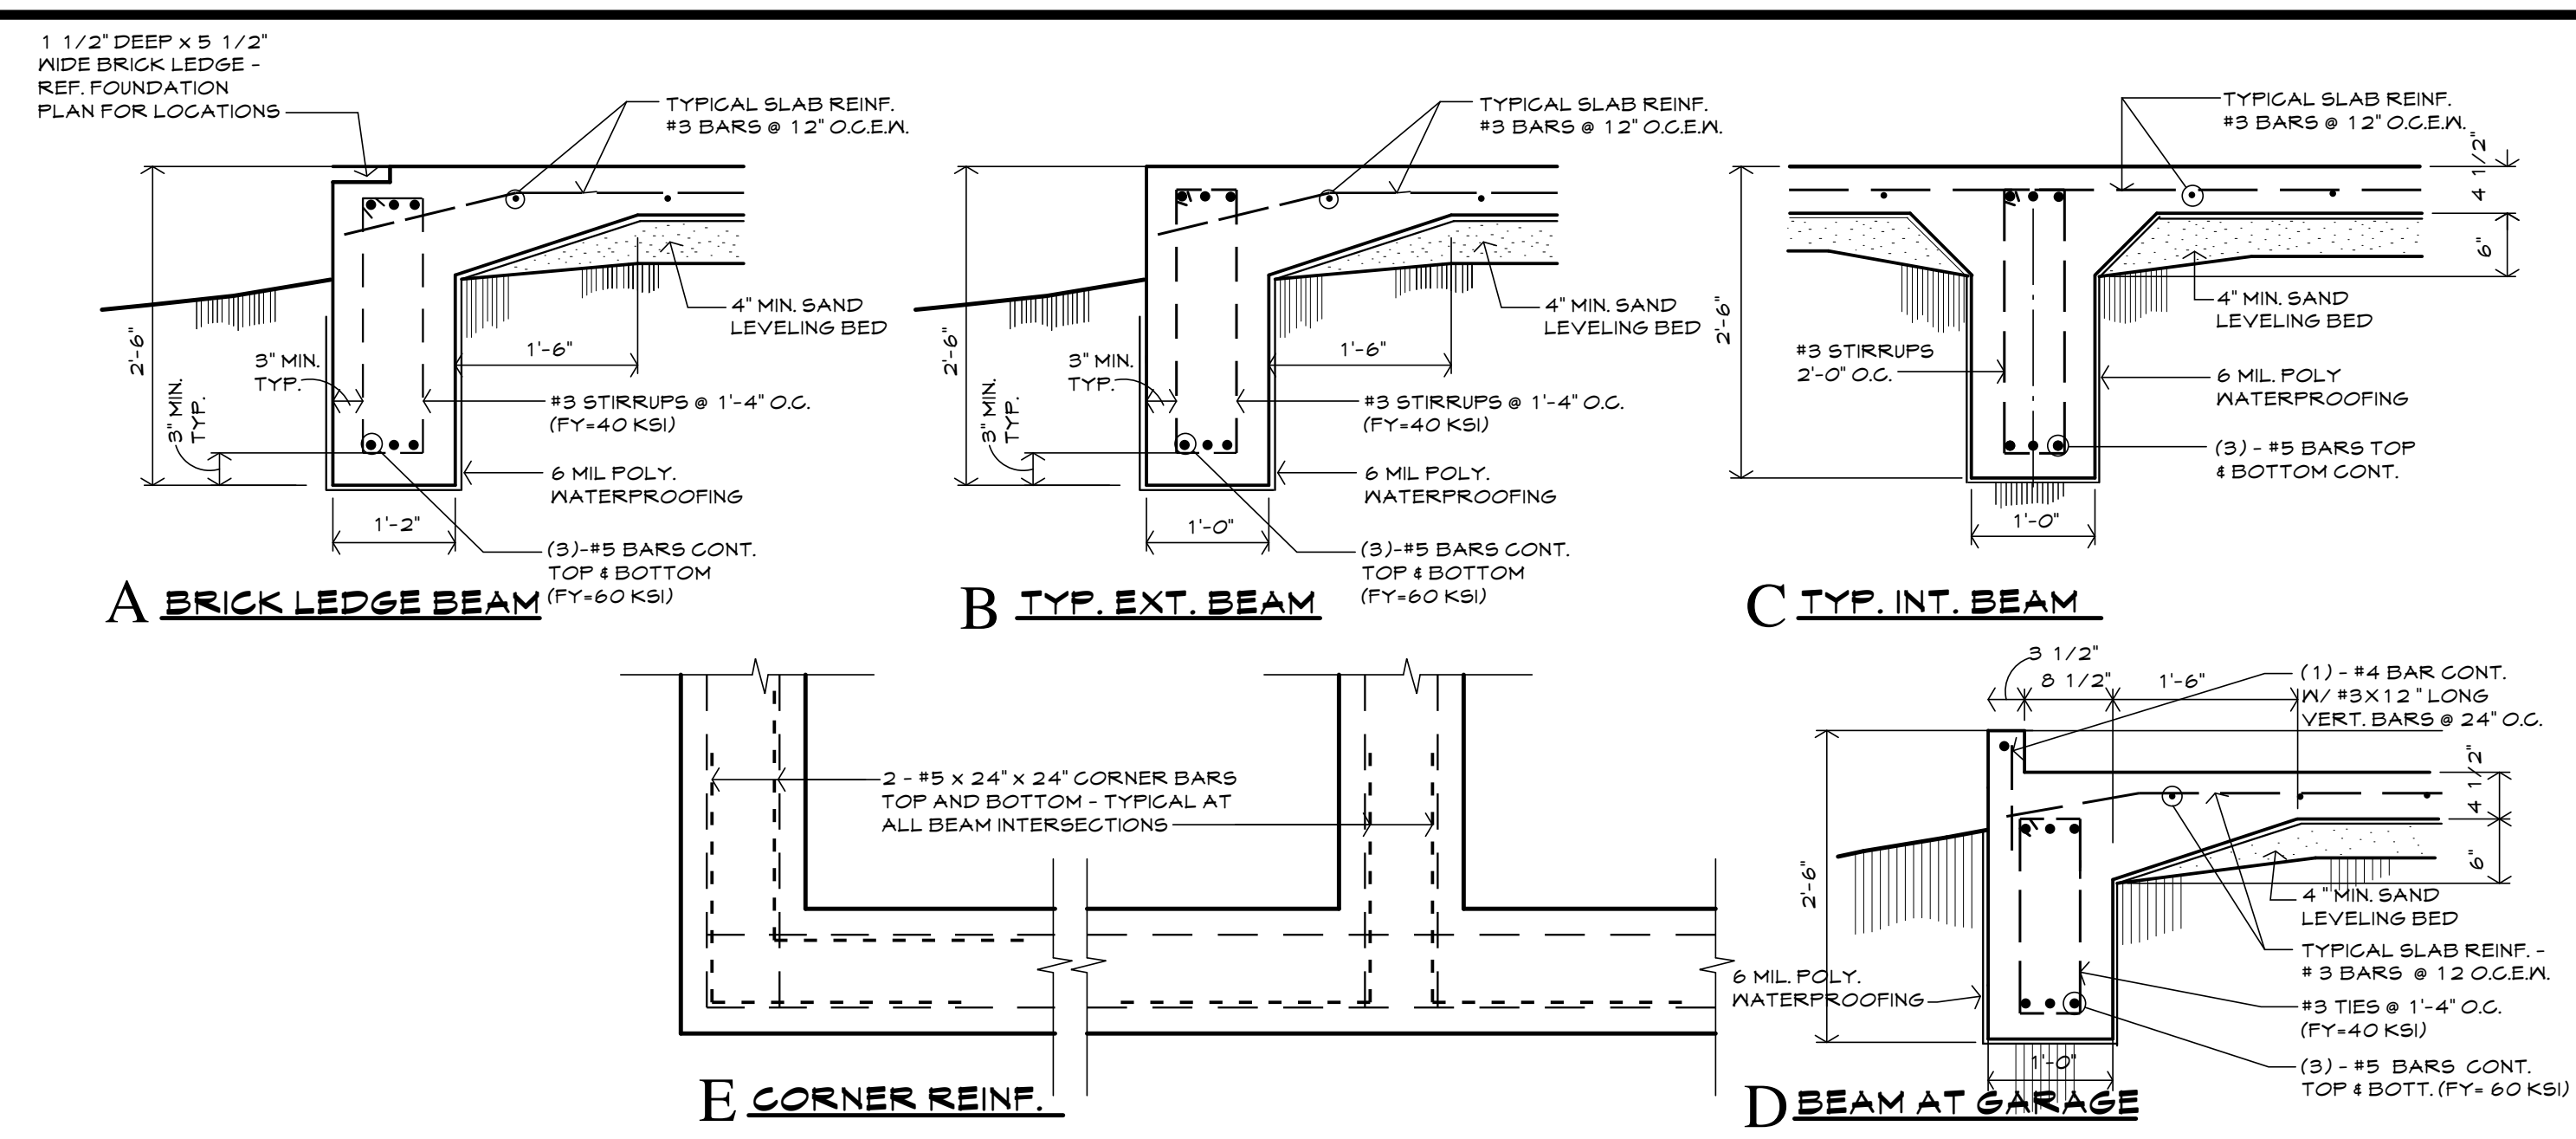


2 FOUNDATION DETAILS
 NOTE: GRADE BEAMS TO EXTEND MIN. 12" INTO UNDISTURBED SOIL
 3/4" = 1'-0"

- GENERAL RESIDENTIAL SPECIFICATIONS**
- GENERAL**
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING ALL DIMENSIONS PRIOR TO CONSTRUCTION AND FOR CHECKING ARCHITECTURAL VERSUS STRUCTURAL DIMENSIONS. THIS SHALL BE COMPLETED PRIOR TO COMMENCEMENT OF WORK. ANY DISCREPANCIES SHALL BE REPORTED TO THE ARCHITECT FOR CHECKING AND ALLOWANCES MADE FOR MINOR REVISIONS.
 - REFER TO ARCHITECTURAL DRAWINGS FOR FLOOR ELEVATIONS, SLOPED OR DEPRESSED FLOOR AREAS, FINISHES, BRICK, LEDGES, ETC.
- FOUNDATION**
- BOTTOMS AND SIDES OF EXCAVATIONS SHALL BE CLEANED BEFORE CONCRETE IS PLACED. ALL WATER OR OTHER DELETERIOUS MATERIALS AND LOOSE SOIL SHALL BE REMOVED FROM THE EXCAVATIONS PRIOR TO CONCRETE PLACEMENT. CONCRETE SHALL BE PLACED IN ALL FOOTINGS ON THE SAME DAY IN WHICH THEY ARE EXCAVATED AND MEASURED TO PREVENT EXCESSIVE DRYING OR MOISTENING OF THE EXCAVATION DURING THE TIMES OPENED SHALL BE TAKEN BY THE CONTRACTOR.
 - ALL FILL MATERIAL SHALL BE FREE OF ANY ORGANICS, CLAY BALLS, OR OTHER DELETERIOUS MATERIALS. IN GENERAL ONLY SELECTED FILL WITH A PL LESS THAN OR EQUAL TO 15 SHALL BE ACCEPTABLE WITH SPECIFIED COMPACTION (ASTM D698).
- CAST-IN-PLACE CONCRETE**
- ALL CONCRETE WORK SHALL BE IN ACCORDANCE WITH THE BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE, ACI 318, LATEST EDITION.
 - ALL CONCRETE FOR STRUCTURES (BEAMS) SHALL BE NORMAL WEIGHT SAND AND GRAVEL AGGREGATE, CONCRETE WITH A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 3000 PSI. CONCRETE MIX SHALL BE 5 BAGS OF CEMENT PER CUBIC YARD. CONCRETE STRENGTHS FOR THE AVERAGE OF ONE PAIR OF STRENGTH TESTS (CYLINDER BREAKS) THAT FALL BELOW THE REQUIRED MINIMUM SHALL BE CAUSE FOR REMOVAL OF PORTIONS OF THE WORK REPRESENTED BY THOSE TESTS.
 - THERE SHALL BE NO HORIZONTAL JOINTS IN CONCRETE WORK, OTHER THAN THOSE SPECIFICALLY SHOWN, AND ALL CONSTRUCTION JOINTS SHALL BE APPROVED BY THE ARCHITECT OR ENGINEER. ANY STOP IN CONCRETE PLACEMENT SHALL BE MADE WITH VERTICAL BULKHEADS INCORPORATING A SHEAR KEY AT THE CENTER OF SPANS BUT ONLY UPON THE APPROVAL OF THE STRUCTURAL ENGINEER.
 - FORMWORK DESIGN IS THE RESPONSIBILITY OF THE CONTRACTOR AND SHALL NOT BE REMOVED UNTIL THE CONCRETE HAS REACHED SUFFICIENT STRENGTH TO CARRY ITS OWN WEIGHT. REMOVAL OF BOTTOM FORMS ON GRADE BEAMS SHALL BE APPROVED BY THE ARCHITECT OR ENGINEER. ADDITIONAL STRENGTH TEST BY INDICES MAY BE ADVISABLE TO CERTIFY ACCEPTABLE STRENGTH TEST FOR FORM REMOVAL. IN NO CASE SHALL BOTTOM FORMS, IF REQUIRED, BE REMOVED PRIOR TO 7 DAYS AFTER PLACEMENT OF CONCRETE.
 - UNLESS OTHERWISE NOTED, CONCRETE COVER FOR REINFORCING STEEL SHALL BE:
 GRADE BEAM BOTTOMS 3"
 GRADE BEAM SIDES 3"
 GRADE BEAM TOPS 1 1/2"
 FLOOR SLABS 1 1/2"
 - ALL PENETRATIONS AND SLEEVED HOLES SHALL BE APPROVED BY THE STRUCTURAL ENGINEER.
 - CHAMFER ALL EXPOSED CORNERS 3/4", OR AS SHOWN ON DRAWINGS.
- REINFORCING STEEL**
- ALL REINFORCING STEEL SHALL BE NEW BILLET DOMESTIC DEFORMED BARS CONFORMING TO ASTM A-615, GRADE 60, EXCEPT THAT #3 OR #4 BARS WHICH ARE BENT, (STIRRUPS, TIES OR CORNERS) MAY BE GRADE 40. GRADE MARKS SHALL BE PLAINLY EVIDENT ON ALL GRADE 60 BARS. ALL REINFORCING SHALL BE FREE OF RUST OR MILL SCALE AND SHALL BE STORED ABOVE THE GROUND.
 - DETAILS AND FABRICATION OF REINFORCING BARS SHALL BE IN ACCORDANCE WITH THE MANUAL OF STANDARD PRACTICE, ACI 315, LATEST EDITION, UNLESS SHOWN OTHERWISE. LAP CONTINUOUS BARS 36 BAR DIAMETERS, OR A MINIMUM OF 24" AT SPLICES. LAP SPLICE BEAM TOP REINFORCING AT MID-SPAN, BOTTOM REINFORCING OVER PIERKS OR SUPPORTS.
 - REINFORCING BARS MAY NOT BE WELDED OR OTHERWISE HEATED FOR CUTTING WITHOUT APPROVAL OF THE STRUCTURAL ENGINEER.
 - ALL TOP AND BOTTOM REINFORCEMENT SHALL HAVE 2-#5, 24" X 24" CORNER BARS PLACED WITHIN THEM THAT EXTEND INTO ADJACENT BEAMS AT EXTERIOR CORNERS AND INTERIOR AND EXTERIOR TEES.
 - ALL STIRRUPS SHALL BE CLOSED STIRRUPS, AND ALL SPACINGS START AT 5/2 FROM THE CENTERLINE OF THE SUPPORTS.
 - ALL TOP BARS SHALL BE HOOKED AT DISCONTINUOUS ENDS.
 - PROVIDE NECESSARY TIES AND BAR SUPPORTS AS REQUIRED BY THE MANUAL OF STANDARD PRACTICE, ACI 315, LATEST EDITION. BRICKS, ROCKS OR OTHER MASONRY OR WOOD ARE NOT ACCEPTABLE SUPPORTS. CHAIRS AND BOLSTERS FOR APPLICATION DIRECTLY OVER EARTH, POLY SHEETS, OR FELTS SHALL BE EQUIPPED WITH BOTTOM BEARING PLATES.
 - ALL REINFORCING STEEL SHALL BE FREE FROM ANY BOND REDUCING COATINGS.
 - ALL HOOKS REQUIRED FOR REINFORCING SHALL BE 90 DEGREE HOOKS, UNLESS OTHERWISE SPECIFIED OR APPROVED HOOKS SHALL BE PROVIDED AT ALL DISCONTINUOUS ENDS AND FOR ALL BARS AT GANTILEVERS.
 - CONCRETE COVERAGE FOR THE REINFORCING STEEL SHALL COMPLY WITH ACI 318, LATEST EDITION, ARTICLE 7.1.1, EXCEPT WHERE SPECIFICALLY STATED OTHERWISE.
 - WHERE OPENINGS IN OR PENETRATIONS THROUGH SLABS OR TOPPING SLABS FORM INSIDE CORNERS, PROVIDE DIAGONAL REINFORCING (2-#5 X 4'-0" LONG) ACROSS THE CORNERS EXCEPT WHERE SHOWN OTHERWISE. THIS REINFORCING SHALL BE PLACED 1 1/2" BELOW THE TOP SURFACE OF THE SLAB.

- GENERAL NOTES**
- All soil under the slab shall be treated with a 1% Dursban termite treatment, or equal, by a certified applicator.
 - 6 mil. polyethylene plastic sheeting shall be run continuously under foundation as a vapor barrier.
 - 1/2" x 8" anchor bolts will be placed on 48" centers for all exterior walls.
 - Foundation design shall comply with the City of College Station Foundation Standards.

IT IS OF UTMOST IMPORTANCE TO LANDSCAPE THE AREA AROUND THE STRUCTURE SUCH THAT WATER DRAINS RAPIDLY AWAY FROM THE BUILDING AND PAVEMENT. TO ACCOMPLISH THIS THERE SHOULD BE A MINIMUM OF SIX (6) INCHES OF FALL IN THE FIRST TEN (10) FEET AWAY FROM THE STRUCTURE IN ALL DIRECTIONS. PROPER DRAINAGE MAY BE ACHIEVED WHEN THE FINISH FLOOR ELEVATION IS SET A MINIMUM OF TWELVE (12) INCHES ABOVE THE HIGHEST EXISTING GRADE ELEVATION UNDER THE PERIMETER OF THE STRUCTURE. WATER MUST NEVER BE ALLOWED TO COLLECT OR POND NEXT TO THE FOUNDATION.

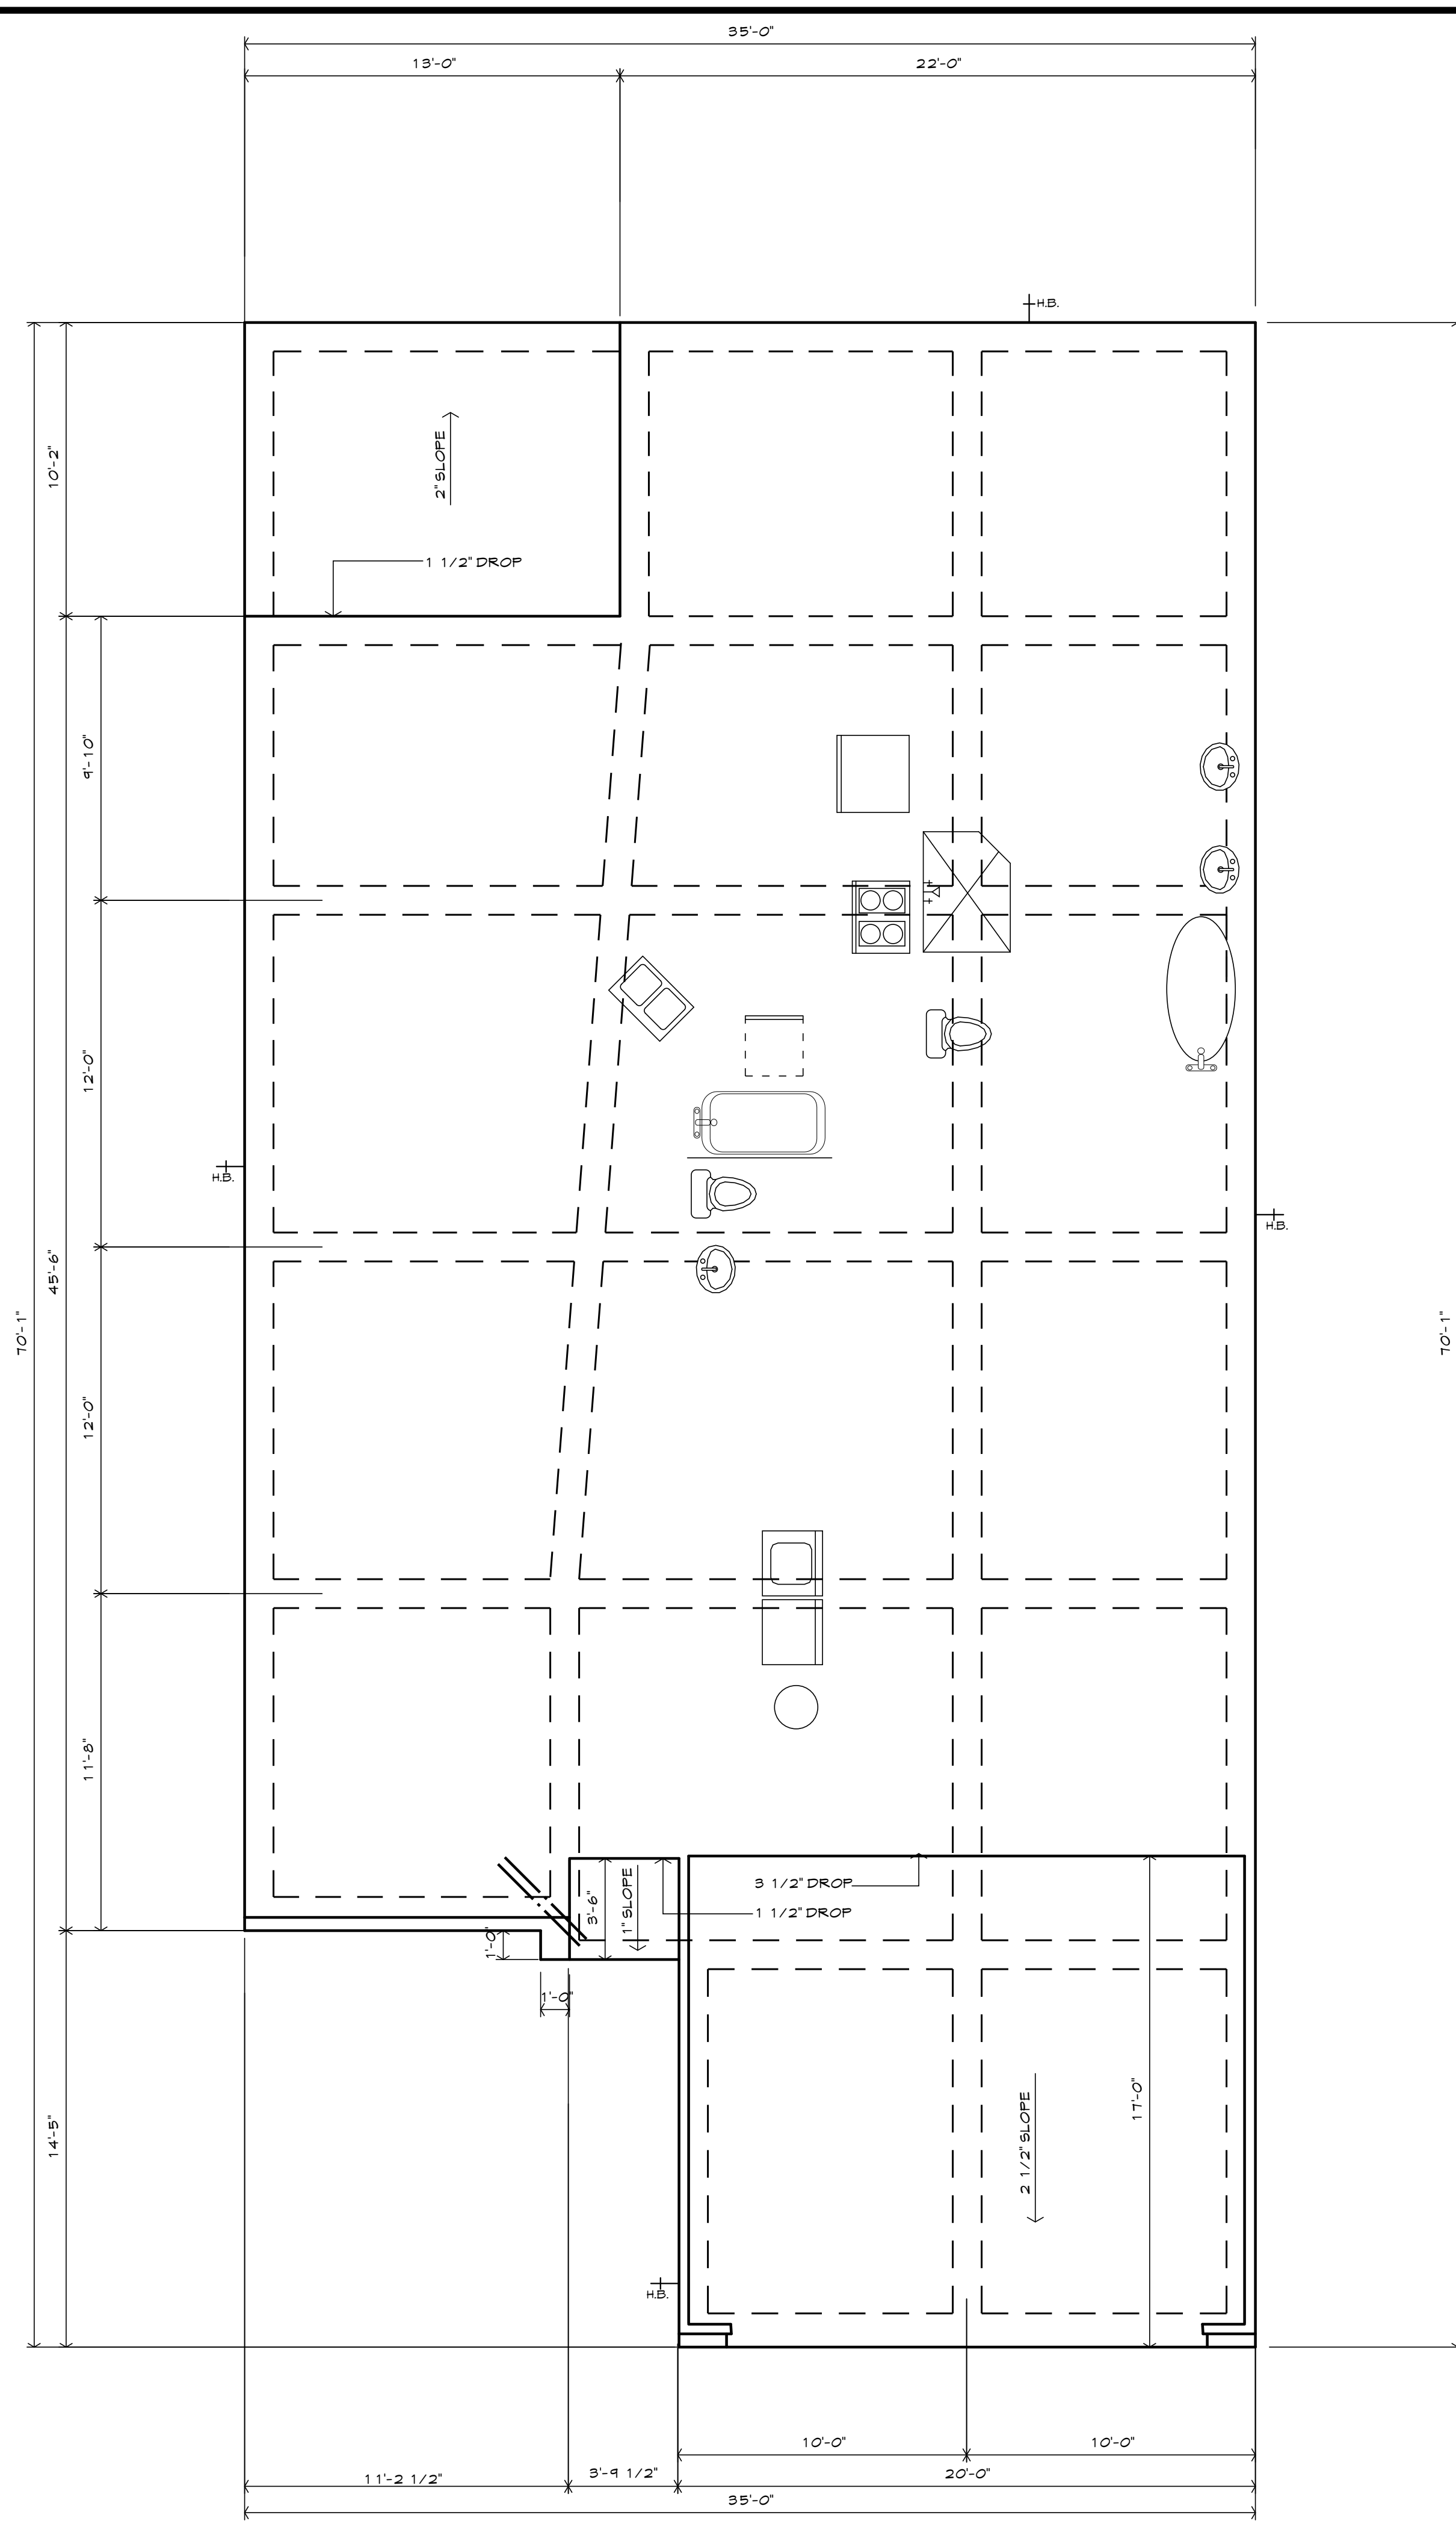

1 FOUNDATION PLAN
 1/4" = 1'-0"